
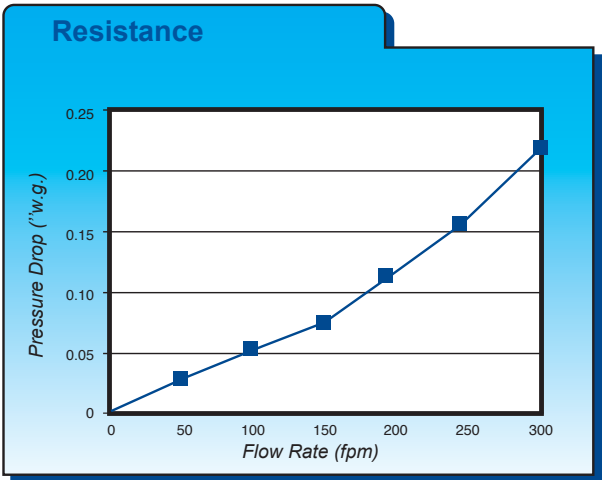


PERFORMANCE DATA

KNTCKPTWRKPKKPIRTKFKPFRPFPPFCPRCTKENKKEKPECFKPKKCNTPETCFCKT
 NYPCNNKRCKPKNTCKPRTFWEEKPTOCKPKRTKFFCKWKPRTRTNEKPKNT
 OTWTRCTKEWNCTCRRNKECKPTWTTSWKTOPKNYCKERTWTTKCPETKIRTTOCPE
 WECPPRFPKPFPPFCRRTKFFIWKFWTNEKPRTERTRT

RTFWE

Independent Test Data	Unit	Results
Rated Air Flow*	fpm	100
Initial Resistance*	"w.g.	0.05
Efficiency on particles 7-10 microns or greater*	%	75

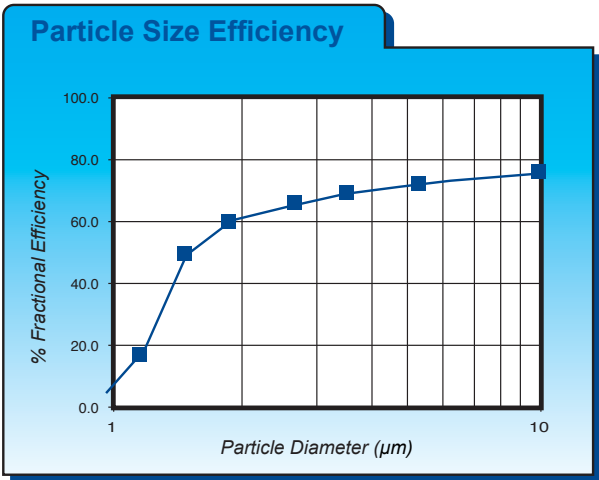

*20" X 20" filter tested per ASHRAE 52.2, Test Aerosol KCl, Neutralized. This test data is based upon clean filter performance. All filters increase in efficiency with dust loading.

Maximum - Superior Performance Requirements:

POCKOWOKEKPEKTSWKTF5TKCPF5TK
 TE OOPFF

PCMRCPNCT

TTSWCNKPFWTKCNKPKKPICPFCKP5RTCKNTCKPTFWETT
 KNTCKPNNTFWEWNNKPCPFCKP5RTCKNTCKPNNTFWEWNNKP



- 6
-
-
-
-